



CIVIL-AID

Ref: CIVIL AID: spl:4/1943 (b)
Test Order dated: 18.12.2014

Date: 04.05.2015

M/s. United Office Systems Pvt. Ltd.,
Plot No. -62/1, 2 & 3, Vill-Vankas,
Taluka-Umbergoan, Dist. Valsad - 396150, Gujarat, India

TEST REPORT ON ACCESS FLOORING SYSTEM

Source of sample Test conducted at : Sample drawn by the customer and conducted at Manufacturers R & D Laboratory.

Customer's Reference : E mail letter dated 22.03.2013

Date of test : 19.12.2014

Tests Conducted : 25 mm Square Load Test,

Sample Identification* : Calcium Sulphate Board Edge Banding (Top HPL/Bottom GI)

Product Model No.* : "UNITILE UCS L/G HG 32 600600 L 120 EB 08194"

Product code No.* : "UNITILE UCS L/G HG 32 600600 L 120 EB 08194"

Panel size (Nominal) : 600 mm x 600 mm

Core Thickness : 30 mm

Thickness /Gross weight of Panel : 32 mm/ 18.400 kg.

Density of Particle Board : 1700 - 1750 kg. /m³


Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum Capacity 4 Ton, Calibration date: 15.09.2014, Due Date: 15.09.2015 & Digital Dial Indicator, Sr. No. 030948 Calibration Date: 10.03.2014, Due Date: 09.03.2015)

Test Method : PAS MOB PF2 PS Clause T08:00


Test Witnessed by : Radhakrishna - Civil-Aid Technoclinic Pvt. Ltd.

25 MM SQUARE LOAD TEST

Sample Reference	UNITILE UCS L/G HG 32 600600 L 120 EB 08194					MOB Clause T 08:00 Requirements
Test Load (kN) Kg.	4.50 (459)					-
Test Height in (mm)	300					-
Location Of Indenter	1st Edge	2nd Edge	Center	3rd Edge	Corner	-
	Deflection In mm					
23 hours	1.57	1.62	1.86	1.64	1.89	1/250 of the span or 2.5mm whichever is the least.
24 hours	1.56	1.60	1.85	1.63	1.88	
Stability	0.01	0.02	0.01	0.01	0.01	Maximum 0.02mm
2Hours after the load was removed	0.11	0.15	0.17	0.16	0.14	Maximum 0.25mm

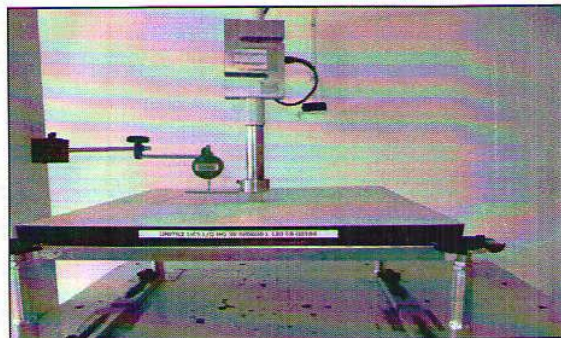

UNITILE UCS L/G HG 32 600600 L 120 EB 08194

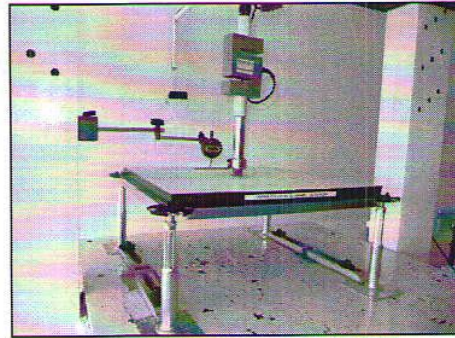

TEST UNDER PROGRESS

* As furnished by the customer

- Note:
1. The results relate only to the items tested.
 2. Report shall not be reproduced, except in full without the written approval of the lab.
 3. Any correction invalidates this report.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

Radhakrishna
Manager - Lab



Civil-Aid Technoclinic Pvt. Ltd.
(A Bureau Veritas Group Company)
43, 45, 46 & 47, Pete Chennappa Ind Estate
Ground & 1st Floor, 1st Main, Magadi Road
Kamakshipalya, Bangalore - 560 079, India
Tel.: +91 80 23011800 Fax: +91 80 26716833

Regd. Off: Marwah Centre, 6th Floor
K. Marwah Marg, Andheri (E), Mumbai - 72
Tel.: +91 22 66956300 Fax: +91 22 66956309
bangalore.lab@in.bureauveritas.com
www.civilaid.com
CIN: U28120MH1997PTC260040

Bangalore (Corp. Off) Tel.: +91 80 39950500
Chennai (Off/Lab) Tel.: +91 44 31924060
Cochin (Off/Lab) Tel.: +91 484 2108800
Hyderabad (Off) Tel.: +91 40 66824582
Hyderabad (Lab) Tel.: +91 40 64584582
Mangalore (Off/Lab) Tel.: +91 824 2213571