



CIVIL - AID

1/2

Ref:CIVIL AID:spl:4/1652/2015 (az)
Test Order dated: 17.04.2015

Date: 26.06.2015

M/s. United Office Systems Pvt. Ltd.,
Plot No. -62/1, 2 & 3, Vill-Vankas,
Taluka-Umbergoan, Dist. Valsad – 396150,
Gujarat , India.

TEST REPORT ON ACCESS FLOORING SYSTEM

Date of test : 19.04.2015
Tests Conducted : Safety Factor - 25 mm Square Load Test
Sample Identification* : Calcium Sulphate Board with Edge Banding
(Top HPL/Bottom GI)
Product Model No.* : "UNITILE UCS L/G HG 34 600600 L 120 EB 08194"
Product code No.* : "UNITILE UCS L/G HG 34 600600 L 120 EB 08194"
Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum
Capacity 4 Ton, Calibration date: 15.09.2014,
Due -Date: 15.09.2015 & Digital Dial Indicator,
Sr. No. 030948 ; Calibration Date: 10.03.2015,
Due Date: 09.03.2016)
Panel size (Nominal) : 600 mm x 600 mm
Core Thickness : 34 mm
Thickness /Gross weight of Panel : 36 mm/ 22.120 kg
Density of Particle Board : 1700 - 1750 kg. /m³
Test Method : PAS MOB PF2 PS Clause T11:00
Test Witnessed by : Umesh. S – Civil-Aid Technoclinic Pvt. Ltd

| Sample Reference | UNITILE UCB L/G HG 34 600600 L 120 EB 08194 | MOB Clause T 11.03 a. Requirements |
|---------------------|--|--|
| Test Load (kN) Kg. | 13.50 (1377) | The System Shall Sustain Three times the particular Static Load For 5 minutes Without Collapse. |
| Test Height in (mm) | 300 | |
| Observation | System did not collapse | |

Contd.....

Radhakrishna
26/6/15
Radhakrishna
Manager - Lab




CIVIL-AID


2/2

Ref:CIVIL AID:spl:4/1652/2015 (az)
Test Order dated: 17.04.2015

Date: 26.06.2015

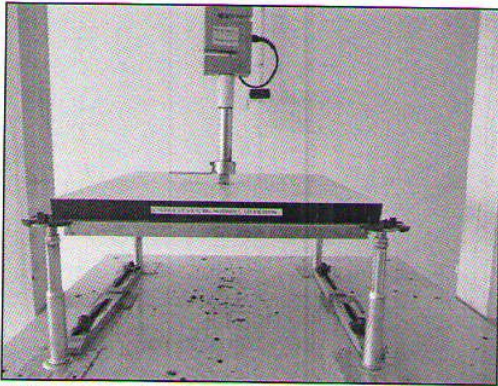

UNITILE UCS L/G HG 34 600600 L 120 EB 08194

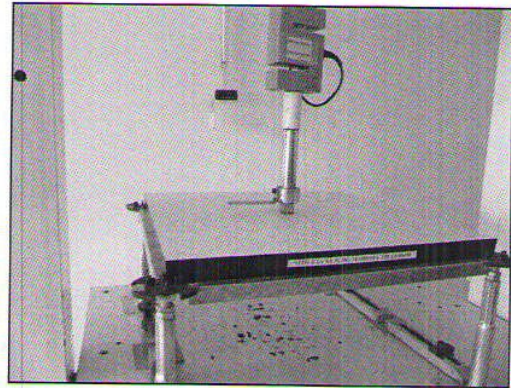

TEST UNDER PROGRESS

* As furnished by the customer

- Note:
1. The results relate only to the items tested.
 2. Report shall not be reproduced, except in full without the written approval of the lab.
 3. Any correction invalidates this report.

for CIVIL AID TECHNOCLINIC PVT.LTD.

Radhakrishna
26/6/15

Radhakrishna
Manager - Lab