



CIVIL - AID

1/2

Ref:CIVILAID:spl:4/1652/2015 (aw)  
Test Order dated: 17.04.2015

Date: 26.06.2015

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan, Dist. Valsad - 396150,  
Gujarat, India.

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Date of test : 22.04.2015  
 Tests Conducted : 25 mm Square Load Test  
 Sample Identification\* : Calcium Sulphate Board with Edge Banding  
 (Top HPL/Bottom GI)  
 Product Model No.\* : "UNITILE UCS L/G HG 34 600600 L 120 EB 08194"  
 Product code No.\* : "UNITILE UCS L/G HG 34 600600 L 120 EB 08194"  
 Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum  
 Capacity 4 Ton, Calibration date: 15.09.2014,  
 Due -Date: 15.09.2015 & Digital Dial Indicator,  
 Sr. No. 030948 ; Calibration Date: 10.03.2015,  
 Due Date: 09.03.2016)  
 Panel size (Nominal) : 600 mm x 600 mm  
 Core Thickness : 34 mm  
 Thickness /Gross weight of Panel : 36 mm/ 22.120 kg  
 Density of Particle Board : 1700 - 1750 kg. /m<sup>3</sup>  
 Test Method : PAS MOB PF2 PS Clause T08:00  
 Test Witnessed by : Umesh. S - Civil-Aid Technoclinic Pvt. Ltd

Sample Reference	UNITILE UCS L/G HG 34 600600 L 120 EB 08194					MOB Clause T 08:00 Requirements
Test Load (kN) kg.	(4.50) 459					-
Test Height in (mm)	300					-
Location of Indenter	1 <sup>st</sup> Edge	2 <sup>nd</sup> Edge	Center	3 <sup>rd</sup> Edge	Corner	-
	Deflection In mm					
23 hours	1.46	1.31	1.28	1.38	1.89	1/250 of the span or 2.5mm whichever is the least.
24 hours	1.45	1.29	1.27	1.37	1.88	
Stability	0.01	0.02	0.01	-0.01	0.01	Maximum 0.02mm
2Hours after the load was removed	0.05	0.08	0.06	0.09	0.06	Maximum 0.25mm

*Umesh S*  
26/06/15

Radhakrishna  
Manager - Lab

Contd.....

Civil-Aid Technoclinic Pvt. Ltd.  
(A Bureau Veritas Group Company)  
43, 45, 46 & 47, Pete Chennappa Inds. Estate  
Ground & 1st Floor, 1st Main, Magadi Road  
Kamakshipalya, Bangalore - 560 079, India  
Tel.: +91 80 23011800 Fax: +91 80 26716833

Regd. Off.: Marwah Centre, 6th Floor  
K. Marwah Marg, Andheri (E), Mumbai - 72  
Tel.: +91 22 66956300 Fax: +91 22 66956309  
bangalore.lab@in.bureauveritas.com  
www.civilaid.com  
CIN: U28120MH1997PTC260040

Bangalore (Corp. Off) Tel.: +91 80 39950500  
Chennai (Off/Lab) Tel.: +91 44 31924060  
Cochin (Off/Lab) Tel.: +91 484 2108800  
Hyderabad (Off) Tel.: +91 40 40045582  
Hyderabad (Lab) Tel.: +91 40 64584582  
Mangalore (Off/Lab) Tel.: +91 824 222222




CIVIL - AID

2/2

Ref:CIVIL AID:spl:4/1652/2015 (aw)  
Test Order dated: 17.04.2015

Date: 26.06.2015

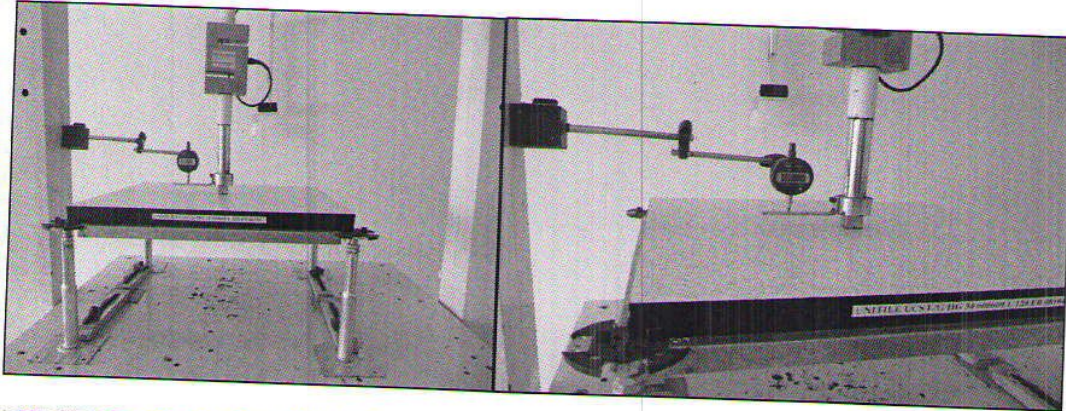

UNITILE UCS L/G HG 34 600600 L 120 EB 08194

TEST UNDER PROGRESS

\* As furnished by the customer

Note: 1.The results relate only to the items tested.  
2 Report shall not be reproduced, except in full without the written approval of the lab.  
3.Any correction invalidates this report.

for CIVIL AID TECHNOCLINIC PVT.LTD.

*Radhakrishna*  
*26/6/15*

Radhakrishna  
Manager - Lab