



**BUREAU  
VERITAS**

Ref: BVIPL/SPL/BL/630/6/2017/102  
Test Order dated: 07.06.2017

Date: 21.07.2017

*NABL Accredited Lab  
as per ISO / IEC: 17025*

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan,  
Dist. Valsad - 396150,  
Gujarat


**TEST REPORT ON ACCESS FLOORING SYSTEM**

Source of sample / material	:	Access Flooring System verified at M/s United Office Systems Pvt. Ltd.
Customer reference	:	Email dated: 07.05.2017 and 14.07.2017
Date of test	:	07.06.2017
Tests Conducted	:	Uniform Load Test
Sample Identification*	:	Steel Cementious Panels (Corner Lock /Laminated)
Product Model No.*	:	"UNITILE USF LFW 35 1500
Product code No.*	:	UNITILE USF LFW 35 1500"
Equipment*	:	U.T.M (Load Cell, Sr. No. 400432, Maximum Capacity 4 Ton Calibration date: 30.03.2017, Due date: 30.03.2018 & Digital Dial Indicator, Sr.No. 030948 Calibration date : 09.03.2017, Due date: 08.03.2018)
Panel size (Nominal)*	:	600 mm x 600 mm
Thickness /Gross weight of Panel*	:	35 mm/ 16.400 kg.
Test Method	:	CISCA 2007, Section-7
Witness by/Date of visit	:	Mr. Radhakrishna, Consultant Bureau Veritas, India Pvt.Ltd, Bangalore on 7.6.17

**TEST RESULTS**

**Uniform Load Test:-**

Sample reference	UNITILE USF LFW 35 1500
Test height in mm.	300
Location of measurement	Center
Deflection(mm) at pre-load of 50lb/ft <sup>2</sup>	0
Load Withstand Maximum Load at 2.54 mm Deflection	2850 kg./m <sup>2</sup>
Residual deflection (mm) at pre-load	0.15

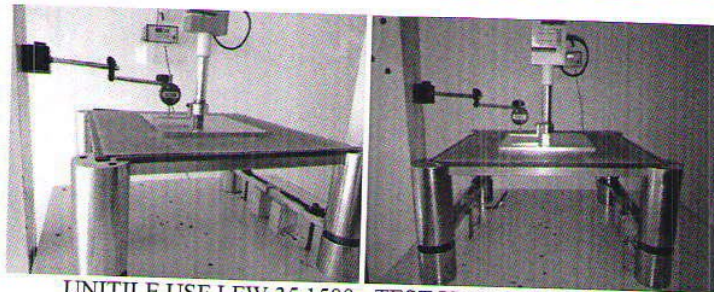

UNITILE USF LFW 35 1500 - TEST UNDER PROGRESS

\* As furnished by the customer

- Note:**
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.

**for BUREAU VERITAS (INDIA) PRIVATE LIMITED  
Construction Services Laboratory**

*(Signature)*  
Bureau Veritas (India) Private Limited  
(Construction Services Laboratory)  
43, 45-47, Pete Chennappa Street,  
Magadi Road, Kamakshipalya, Bangalore - 560 079  
Tel.: +91 80 23011800 Fax: +91 80 26716835  
bangalore.lab@in.bureauveritas.com

**SANJEEV PATGAR  
Manager LAB**

Regd. Off. : Marwah Centre, 6th Floor  
K. Marwah Marg, Off Saki-Vihar Road  
Andheri (East), Mumbai - 400 072. India  
Tel.: +91 22 66956300 Fax: +91 22 66956309  
www.bureauveritas.co.in  
CIN : U74210MH2001PTC134262

Offices/Labs at: Ahmedabad, Baroda  
Bhopal, Chennai, Cochin, Coimbatore  
Delhi, Goa, Hubli, Hyderabad, Indore  
Jaipur, Kakinada, Kandla, Kolkata, Ludhiana  
Mangalore, Nagpur, Nashik, Pune, Raipur  
Surat, Trichy & Visakhapatnam