



**BUREAU
VERITAS**

*NABL Accredited Lab
as per ISO / IEC: 17025*

1/2

Ref: BVIPL/SPL/BL/630/6/2017/125
Test Order dated: 07.06.2017

Date: 27.07.2017

M/s. United Office Systems Pvt. Ltd,
Plot No. -62/1, 2 & 3, Vill-Vankas,
Taluka-Umbergoan,
Dist. Valsad - 396150,
Gujarat

TEST REPORT ON ACCESS FLOORING SYSTEM

Source of sample / material	:	Access Flooring System verified at M/s United Office Systems Pvt. Ltd.
Customer reference	:	Email dated: 07.05.2017 and 23.07.2017
Date of test	:	10.06.2017
Tests Conducted	:	25 mm Square Load Test
Sample Identification*	:	Steel Cementitious Panels (Corner Lock /Laminated)
Product Model No.*	:	"UNITILE USF LFW 35 1250
Product code No.*	:	UNITILE USF LFW 35 1250"
Equipment*	:	U.T.M (Load Cell, Sr. No. 400432, Maximum Capacity 4 Ton Calibration date: 30.03.2017, Due date: 30.03.2018 & Digital Dial Indicator, Sr.No. 030948 Calibration date : 09.03.2017, Due date: 08.03.2018)
Panel size (Nominal)*	:	600 mm x 600 mm
Thickness /Gross weight of Panel*	:	35 mm/ 16.100 kg.
Test Method	:	PSA MOB PF2 PS
Witness by/Date of visit	:	Mr. Radhakrishna, Consultant Bureau Veritas, India Pvt.Ltd, Bangalore on 10.6.17

TEST RESULTS

25 mm Square Load Test:-

Sample Reference	UNITILE USF LFW 35 1250					PSA MOB PF2 PS Clause T 08:00 Requirements
	1st Edge	2nd Edge	center	3rd Edge	Corner	
Test Load (kN) Kg.	(5.55) 567					-
Test Height in (mm)	300					-
Location Of Indenter	Deflection In mm					1/250 of the span or 2.5mm whichever is the least.
	23 hours	1.89	1.86	1.99	1.78	
24 hours	1.90	1.87	2.00	1.79	1.52	
Stability	0.01	0.01	0.01	0.01	0.01	Maximum 0.02mm
2Hours after the load was removed	0.05	0.08	0.03	0.04	0.02	Maximum 0.50mm

[Signature]
29/07/2017
SANJEEV PATGAR
Manager LAB

contd...../-


Bureau Veritas (India) Private Limited
(Construction Services Laboratory)
43, 45-47, Pete Chennappa Inds. Estate, 1st Main
Magadi Road, Kamakshipalya, Bangalore - 560 079
Tel.: +91 80 23011800 Fax: +91 80 26716833
bangalore.lab@in.bureauveritas.com

Regd. Off. : Marwah Centre, 6th Floor
K. Marwah Marg, Off Saki-Vihar Road
Andheri (East), Mumbai - 400 072, India
Tel.: +91 22 66956300 Fax: +91 22 66956309
www.bureauveritas.co.in
CIN : U74210MH2001PTC134262

Offices/Labs at: Ahmedabad, Baroda
Bhopal, Chennai, Cochin, Coimbatore
Delhi, Goa, Hubli, Hyderabad, Indore
Jaipur, Kakinada, Kandla, Kolkata, Ludhiana
Mangalore, Nagpur, Nashik, Pune, Raipur
Surat, Trichy & Visakhapatnam

Ref: BVIPL/SPL/BL/630/6/2017/125
Test Order dated: 07.06.2017

Date: 27.07.2017

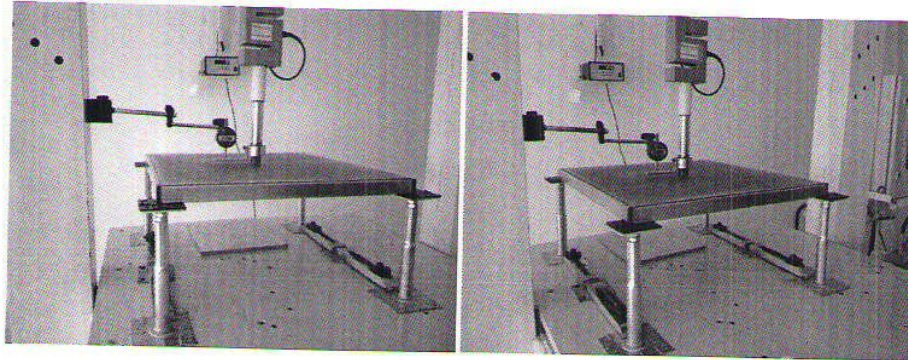


UNITILE USF LFW 35 1250 - TEST UNDER PROGRESS

* As furnished by the customer

- Note:
1. The results relate only to the items tested.
 2. Report shall not be reproduced, except in full without the written approval of the lab.
 3. Any correction invalidates this report.

for BUREAU VERITAS (INDIA) PRIVATE LIMITED
Construction Services Laboratory


29/07/2017
SANJEEV PATGAR
Manager LAB