



**BUREAU  
VERITAS**

NABL Accredited Lab  
as per ISO / IEC: 17025

1/2

Ref: BVIPL/SPL/BL/630/6/2017/126  
Test Order dated: 07.06.2017

Date: 27.07.2017

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan,  
Dist. Valsad - 396150,  
Gujarat

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Source of sample / material : Access Flooring System verified at M/s United Office Systems Pvt. Ltd.  
Customer reference : Email dated: 07.05.2017 and 23.07.2017  
Date of test : 08.06.2017  
Tests Conducted : Uniformly Distributed Load Test  
Sample Identification\* : Steel Cementitious Panels (Corner Lock /Laminated)  
Product Model No.\* : "UNITILE USF LFW 35 1250"  
Product code No.\* : UNITILE USF LFW 35 1250"  
Equipment\* : U.T.M (Load Cell, Sr. No. 400432, Maximum Capacity 4 Ton  
Calibration date: 30.03.2017, Due date: 30.03.2018 & Digital  
Dial Indicator, Sr.No. 030948 Calibration date : 09.03.2017,  
Due date: 08.03.2018)  
Panel size (Nominal)\* : 600 mm x 600 mm  
Thickness /Gross weight of Panel\* : 35 mm/ 16.100 kg.  
Test Method : PSA MOB PF2 PS  
Witness by/Date of visit : Mr. Radhakrishna, Consultant  
Bureau Veritas, India Pvt.Ltd, Bangalore on 8.6.17

**TEST RESULTS**

**Uniformly Distributed Load Test:-**

Sample Reference	UNITILE USF LFW 35 1250					PSA MOB PF2 PS Clause T10:00 Requirements
Test Load (kg/m <sup>2</sup> )	1701					-
Test Height in (mm)	300					-
Location Of Indenter	1st Edge	2nd Edge	center	3rd Edge	4th Edge	-
	Bottom Deflection In mm					
23 hours	1.51	1.48	1.56	1.67	1.48	1/250 of the span or 2.5mm whichever is the least.
24 hours	1.52	1.49	1.57	1.68	1.48	
Stability	0.01	0.01	0.01	0.01	0.00	Maximum 0.02mm
2 Hours after the load was removed	0.12	0.10	0.09	0.15	0.09	Maximum 0.50 mm

contd...../-

Bureau Veritas (India) Private Limited  
(Construction Services Laboratory)  
43, 45-47, Pete Chennappa Inds. Estate, 1st Main  
Magadi Road, Kamakshipalya, Bangalore - 560 079  
Tel.: +91 80 23011800 Fax: +91 80 26716833  
bangalore.lab@in.bureauveritas.com


**SANJEEV PATGAR**  
Manager, LAB

Head. Off. : Marwah Centre, 6th Floor  
K. Marwah Marg, Off Saki-Vihar Road  
Andheri (East), Mumbai - 400 072. India  
Tel.: +91 22 66956300 Fax: +91 22 66956309  
www.bureauveritas.co.in  
CIN : U74210MH2001PTC134262

Offices/Labs at: Ahmedabad, Baroda  
Bhopal, Chennai, Cochin, Coimbatore  
Delhi, Goa, Hubli, Hyderabad, Indore  
Jaipur, Kakinada, Kandla, Kolkata, Ludhiana  
Mangalore, Nagpur, Nashik, Pune, Raipur  
Surat, Trichy & Visakhapatnam

Ref: BVIPL/SPL/BL/630/6/2017/126  
Test Order dated: 07.06.2017

Date: 27.07.2017

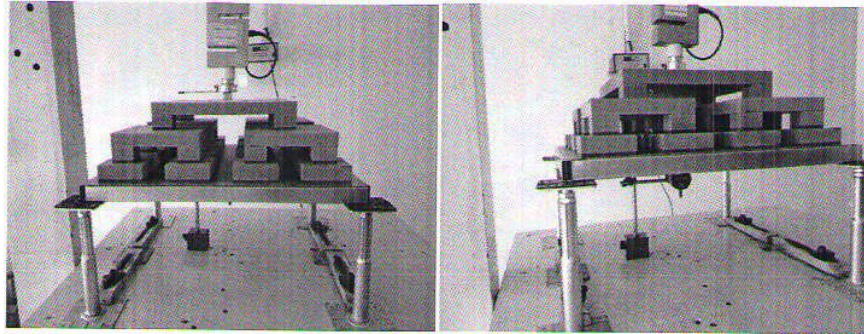


UNITILE USF LFW 35 0800 - TEST UNDER PROGRESS

\* As furnished by the customer

- Note:
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.

for BUREAU VERITAS (INDIA) PRIVATE LIMITED  
Construction Services Laboratory

  
29/07/2017  
SANJEEV PATGAR  
Manager LAB