



CIVIL-AID

Ref:CIVILAIID:spl:4/1314 (ao)
Test Order dated: 17.04.2013

Date: 30.04.2013

M/s. United Office Systems Pvt. Ltd.,
Plot No. -62/1, 2 & 3, Vill-Vankas,
Taluka-Umbergoan,
Dist. Valsad – 396150,
Gujarat , India

Attn.: Sri. Shabbir Rajkotwala

TEST REPORT ON ACCESS FLOORING SYSTEM

Source of sample : Sample supplied by the customer
Customer's Reference : E mail letter dated 22.03.2013
Date of test : 15.04.2013
Tests Conducted : Rolling Load Test : Wheel A -10 passes
Sample Identification* : Steel Cementitious Panels with folded edges
Product Model No.* : "UNITILE UNIFOLD UFP 800 Folded Edge (Bare)"
Product code No.* : UNITILE UFP 6400 0800 B 000 00 00000
Panel size (Nominal) : 600 mm x 600 mm
Thickness /Gross weight of Panel : 30 mm/ 12.900 kg.
Test Method : CISCA 2003-2004 –
Recommended test procedures for Access Floor

TEST RESULTS

Table 1: Rolling Load Test by 3"x 1^{13/16}" (76mm x 46mm)Wheel

| Sample Reference | UNITILE UFP 30 0800 (Corner Lock) valid for FFH 150-600mm | | |
|-----------------------|---|-----------|--|
| Test load in kg (lbf) | 217 (480) | | |
| Measurement taken at | 0 pass | 10 passes | Deflection at 10 passes relative to 0 passes |
| Edge 1-2 (mm) | -0.02 | -0.55 | -0.53 |
| Edge 2-3 (mm) | -0.03 | -0.42 | -0.39 |
| Edge 3-4 (mm) | -0.12 | -0.58 | -0.46 |
| Edge 4-1 (mm) | -0.05 | -0.34 | -0.29 |
| Diagonal 1-3 (mm) | -0.12 | -0.68 | -0.56 |
| Diagonal 2-4 (mm) | -0.31 | -0.62 | -0.31 |
| Center A (mm) | -0.14 | -0.53 | -0.39 |
| Center B (mm) | -0.03 | -0.42 | -0.40 |
| Center C (mm) | -0.08 | -0.43 | -0.35 |
| Center D (mm) | -0.14 | -0.39 | -0.25 |
| Center E (mm) | -0.12 | -0.67 | -0.55 |
| Center F (mm) | -0.08 | -0.59 | -0.51 |

Note: All negative denote downward deflection

Radha Krishna
30/4/13

RADHA KRISHNA
Sr. Technical Officer



Contd.....

Civil-Aid Technoclinic Pvt. Ltd.
1030, 13th Cross
Banashankari 2nd Stage
Bangalore - 560 070. India

Tel. : +91 80 39950500, 26716831
Fax : +91 80 26716833
ctccivilaidinfo.in@in.bureauveritas.com
www.civilaid.com

Chennai (Off/Lab) Tel.: +91 44 24847345
Hyderabad (Off) Tel.: +91 40 66824582
Hyderabad (Lab) Tel.: +91 40 64584582
Mangalore (Off/Lab) Tel.: +91 824 2213571



CIVIL - AID

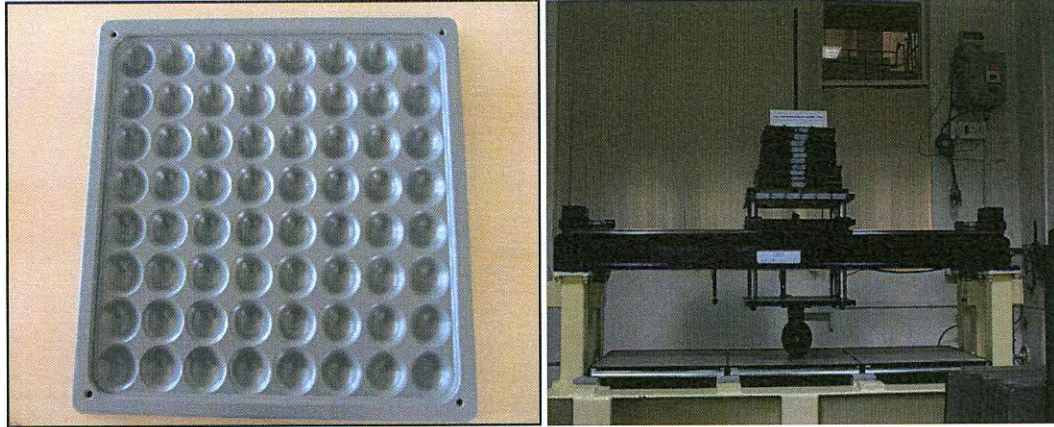


PHOTO 1: Images of UNITILE UFP 30 0800 (Corner Lock) before /while Testing

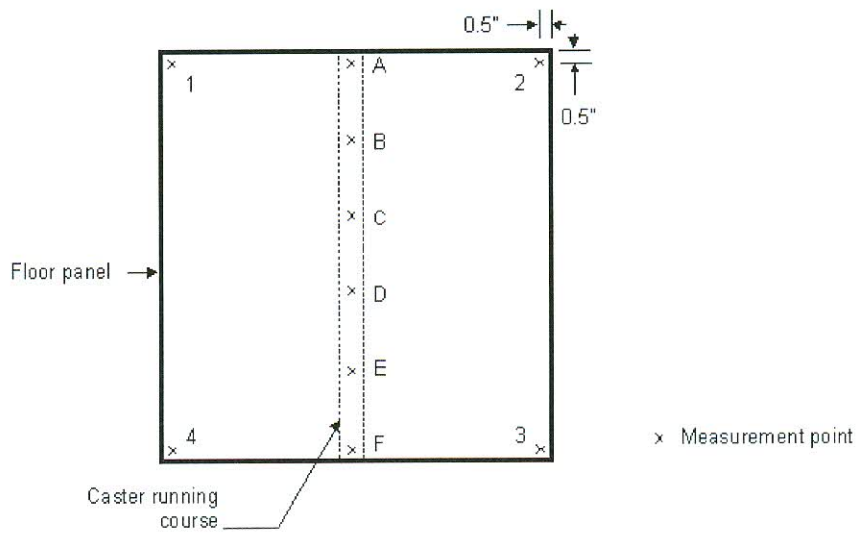


Figure 1: Position of Measurement (Rolling Load)

* As furnished by the customer

- Note:
- 1.The results relate only to the items tested.
 - 2.Report shall not be reproduced, except in full without the written approval of the lab.
 - 3.Any correction invalidates this report.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

Handwritten signature and date: Radha Krishna, 3/8/4/13

RADHA KRISHNA
Sr. Technical Officer

