



CIVIL - AID

Ref:CIVIL AID:spl:4/1652/2015 (z)  
Test Order dated: 17.04.2015

Date: 26.06.2015

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan, Dist. Valsad – 396150,  
Gujarat , India.

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Date of test : 15.05.2015  
 Tests Conducted : Uniformly Distributed Load Test  
 Sample Identification\* : Chip Board Edge Banding (Top Vitrified /Bottom GI)  
 Product Model No.\* : "UNITILE UCB V/G HG 35 600600 100 EB K6301"  
 Product code No.\* : "UNITILE UCB V/G HG 35 600600 100 EB K6301"  
 Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum Capacity 4 Ton, Calibration date: 03.04.2015, Due Date: 03.04.2016 & Digital Dial Indicator, Sr. No. 030948 Calibration Date: 10.03.2015, Due Date: 09.03.2016)  
 Panel size (Nominal) : 600 mm x 600 mm  
 Core Thickness : 35 mm  
 Thickness /Gross weight of Panel : 47 mm/ 17.240 kg.  
 Density of Particle Board : 630.00 – 730.00 kg. /m  
 Test Method : PAS MOB PF2 PS Clause T10.00  
 Test Witnessed by : Umesh S – Civil-Aid Technoclinic Pvt. Ltd

**TEST RESULTS**

**Uniformly Distributed Load Test**

Sample Reference	UNITILE UCB V/G HG 35 600600 100 EB K6301					MOB Clause T10:00 Requirements
Test Load (kg/m <sup>2</sup> )	1377.00					-
Test Height in (mm)	FFH 300 mm					-
Location Of Indenter	1st Edge	2nd Edge	center	3rd Edge	4th Edge	-
	Bottom Deflection In mm					
23 hours	2.10	2.19	2.09	2.12	2.18	1/250 of the span or 2.5mm whichever is the least.
24 hours	2.11	2.20	2.08	2.11	2.17	
Stability	0.01	0.01	0.01	0.01	0.01	Maximum 0.02mm
2 Hours after the load was removed	0.10	0.12	0.07	0.09	0.12	Maximum 0.25mm

*Radhakrishna*  
 26/6/15  
 Radhakrishna  
 Manager - Lab


Contd.....



CIVIL-AID

Ref:CIVIL AID:spl:4/1652/2015 (z)  
Test Order dated: 17.04.2015

Date: 26.06.2015

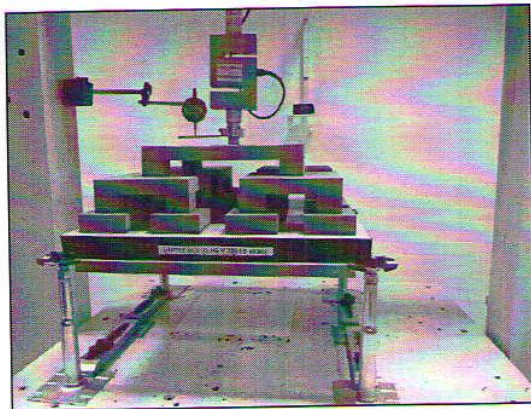

UNITILE UCB V/G HG 35 600600 100 EB K6301



TEST UNDER PROGRESS

\* As furnished by the customer

- Note:
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.
  4. K60301 is Shade code of the Vitrified top finish it May change As Per customer requirement.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

*Radhakrishna*  
26/6/15  
**Radhakrishna**  
Manager - Lab