



CIVIL - AID

Ref:CIVILAID:spl:4/1652/2015 (ac)
Test Order dated: 17.04.2015

Date: 26.06.2015

M/s. United Office Systems Pvt. Ltd.,
Plot No. -62/1, 2 & 3, Vill-Vankas,
Taluka-Umbergoan, Dist. Valsad – 396150,
Gujarat , India.

TEST REPORT ON ACCESS FLOORING SYSTEM

Date of test : 18.05.2015
 Tests Conducted : Safety Factor - 25 mm Square Load Test
 Sample Identification* : Chip Board Edge Banding (Top Vitrified /Bottom GI)
 Product Model No.* : "UNITILE UCB V/G HG 35 600600 100 EB K6301"
 Product code No.* : "UNITILE UCB V/G HG 35 600600 100 EB K6301"
 Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum Capacity 4 Ton, Calibration date: 03.04.2015, Due Date: 03.04.2016 & Digital Dial Indicator, Sr. No. 030948 Calibration Date: 10.03.2015, Due Date: 09.03.2016)
 Panel size (Nominal) : 600 mm x 600 mm
 Core Thickness : 35 mm
 Thickness /Gross weight of Panel : 47 mm/ 17.240 kg.
 Density of Particle Board : 630.00 – 730.00 kg. /m³
 Test Method : PAS MOB PF2 PS Clause T11.00
 Test Witnessed by : Umesh S – Civil-Aid Technoclinic Pvt. Ltd

TEST RESULTS

Safety Factor - 25 mm Square Load Test

Sample Reference	UNITILE UCB V/G HG 35 600600 100 EB K6301	MOB Clause T 11.03 a. Requirements
Test Load (kN) Kg.	13.50 (1377)	The System Shall Sustain Three times the particular Static Load For 5 minutes Without Collapse.
Test Height in (mm)	300	
Observation	System did not collapse	

Radhakrishna
 26.6.15
Radhakrishna
 Manager - Lab



Contd.....



CIVIL-AID

Ref: CIVIL AID: spl: 4/1652/2015 (ac)
Test Order dated: 17.04.2015

Date: 26.06.2015

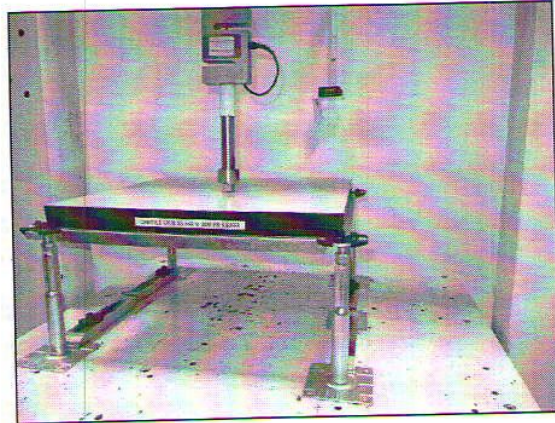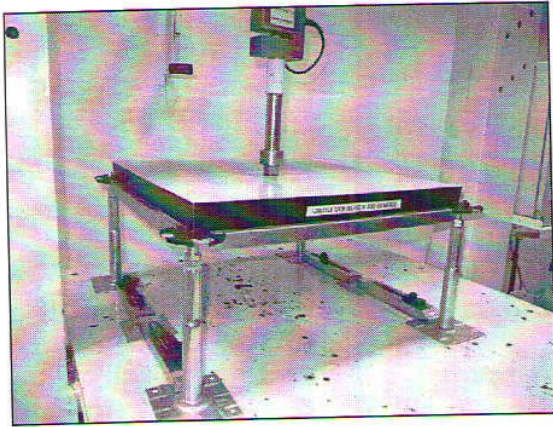

UNITILE UCB V/G HG 35 600600 100 EB K6301

TEST UNDER PROGRESS

* As furnished by the customer

- Note:
1. The results relate only to the items tested.
 2. Report shall not be reproduced, except in full without the written approval of the lab.
 3. Any correction invalidates this report.
 4. K6301 is Shade code of the Vitrified top finish it May change As Per customer requirement.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

Radhakrishna
26.6.15
Radhakrishna
Manager - Lab