



**BUREAU  
VERITAS**

1/2

Ref: BVIPL/SPL/BL/630/6/2017/161  
Test Order dated: 07.06.2017

Date: 1.09.2017

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan,  
Dist. Valsad - 396150,  
Gujarat

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Source of sample / material : Access Flooring System verified at M/s United Office Systems Pvt. Ltd.  
Customer reference : Email dated: 07.05.2017 and 1.09.2017  
Date of test : 10.6.2017  
Tests Conducted : a. Concentrated Load Test, b. Ultimate Load Test  
Sample Identification\* : Steel Cementious Panels with folded edge (Bare)  
Product Model No.\* : "UNITILE UFP 30 1650  
Product code No.\* : "UNITILE UFP 30 1650 B 000 00 00000"  
Equipment used\* : U.T.M (Load Cell, Sr. No. 400432, Maximum Capacity 4 Ton  
Calibration date: 30.03.2017, Due date: 30.03.2018 & Digital  
Dial Indicator, Sr.No. 030948 Calibration date : 09.03.2017,  
Due date: 08.03.2018)  
Panel size (Nominal)\* : 600 mm x 600 mm  
Thickness /Gross weight of Panel\* : 30 mm/ 13.000 kg.  
Test Method : CISCA 2007, Section-1, Section-2  
Witness by/Date of visit : Mr. Radhakrishna, Consultant  
Bureau Veritas, India Pvt. Ltd, Bangalore on 10.6.17

**TEST RESULTS**

Table 1: Concentrated Load Test

Sample reference	UNITILE UFP 30 1650 Bare		
	Center	Edge	Corner(**)
Test height in mm	300		
Location of indentor	Center	Edge	Corner(**)
Deflection in mm at pre-load of 22.7 kg	0.00		
Deflection in mm at load of 360kg ( 3.53 kN)	1.73	1.91	1.83
Residual deflection in mm at pre-load	0.04	0.08	0.07

*Sanjeev Patgar*  
02/09/2017

**SANJEEV PATGAR**  
Manager LAB

contd...../-

Bureau Veritas (India) Private Limited  
(Construction Services Laboratory)  
43, 45-47, Pete Chennappa Inds. Estate, 1st Main  
Magadi Road, Kamakshipalya, Bangalore - 560 079  
Tel.: +91 80 23011800 Fax: +91 80 26716833  
bangalore.lab@in.bureauveritas.com

Regd. Off. : Marwah Centre, 6th Floor  
K. Marwah Marg, Off Saki-Vihar Road  
Andheri (East), Mumbai - 400 072. India  
Tel.: +91 22 66956300 Fax: +91 22 66956309  
www.bureauveritas.co.in  
CIN : U74210MH2001PTC134262


Offices/Labs at: Ahmedabad, Baroda  
Bhopal, Chennai, Cochin, Coimbatore  
Delhi, Goa, Hubli, Hyderabad, Indore  
Jaipur, Kakinada, Kandla, Kolkata, Ludhiana  
Mangalore, Nagpur, Nashik, Pune, Raipur  
Surat, Trichy & Visakhapatnam

Ref: BVIPL/SPL/BL/630/6/2017/161  
 Test Order dated: 07.06.2017

Date: 1.09.2017

Table 2: Ultimate Load Test

Sample reference	UNITILE UFP 30 1650 Bare		
Test height in mm	300		
Location of indenter	Center	Edge	Corner(**)
Maximum load in kg (k N)	1142(11.19)	1105(10.83)	1102 (10.80)

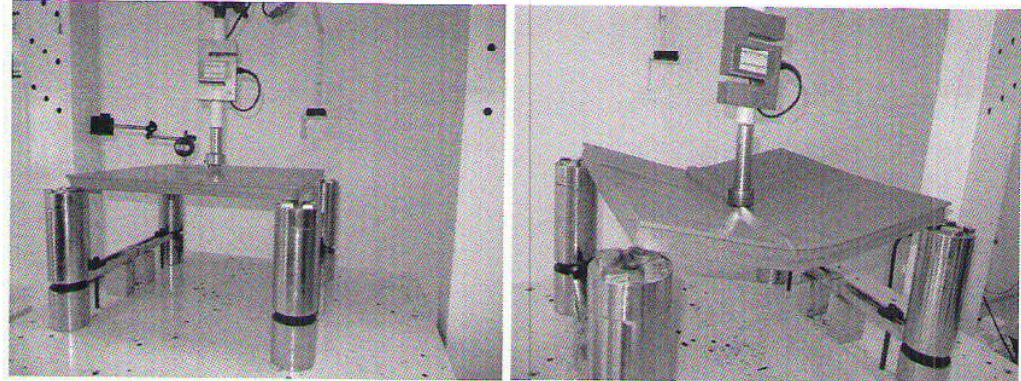

UNITILE UFP 30 1650 Bare - TEST UNDER PROGRESS


Remarks :

1. The panel is supported with 4 steel block jigs.
  2. A new bare panel is used for each test. ( Center, Edge, Corner \*\*)
- \*\* - Weakest point is located at about 220mm x 220mm from the corners.

\* As furnished by the customer

- Note:
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.

**for BUREAU VERITAS (INDIA) PRIVATE LIMITED**  
**Construction Services Laboratory**

  
 02/09/2017  
**SANJEEV PATGAR**  
 Manager LAB