



CIVIL - AID

Ref: CIVIL AID: spl: 4/1943 (v)  
Test Order dated: 18.12.2014

Date: 04.05.2015

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan, Dist. Valsad - 396150,  
Gujarat, India

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Source of sample Test conducted at : Sample drawn by the customer and conducted at Manufacturers R & D Laboratory.

Customer's Reference : E mail letter dated 22.03.2013

Date of test : 17.12.2014

Tests Conducted : Safety Factor - 25 mm Square Load Test

Sample Identification\* : Chip Board Edge Banding (Top HPL/Bottom GI)

Product Model No.\* : "UNITILE UCB L/G HG 35 600600 L 120 EB 08194"

Product code No.\* : "UNITILE UCB L/G HG 35 600600 L 120 EB 08194"

Thickness /Gross weight of Panel : 35 mm/ 10.560 kg.

Density of Particle Board : 715.00 - 730.00 kg. /m<sup>3</sup>


Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum Capacity 4 Ton, Calibration date: 15.09.2014, Due Date: 15.09.2015 & Digital Dial Indicator, Sr. No. 030948 Calibration Date: 10.03.2014, Due Date: 09.03.2015)

Test Method : PAS MOB PF2 PS Clause T11:00


Test Witnessed by : Radhakrishna - Civil-Aid Technoclinic Pvt. Ltd.

**SAFETY FACTOR - 25 MM SQUARE LOAD TEST**

Sample Reference	UNITILE UCB L/G HG 35 600600 L 120 EB 08194	MOB Clause T 11.03 a. Requirements
Test Load (kN) Kg.	13.50 (1377)	The System Shall Sustain Three times the particular Static Load For 5 minutes Without Collapse.
Test Height in (mm)	300	
Observation	System did not collapse	

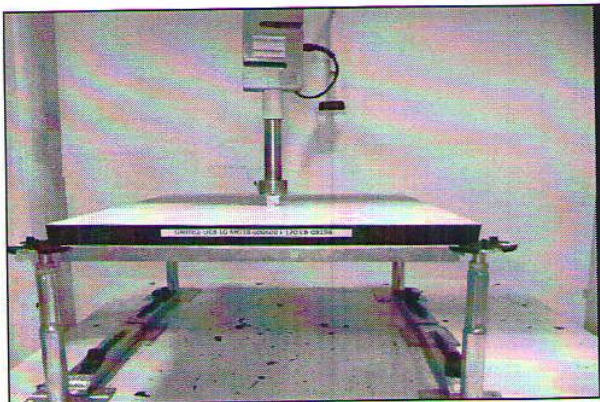

**UNITILE UCB L/G HG 35 600600 L 120 EB 08194**

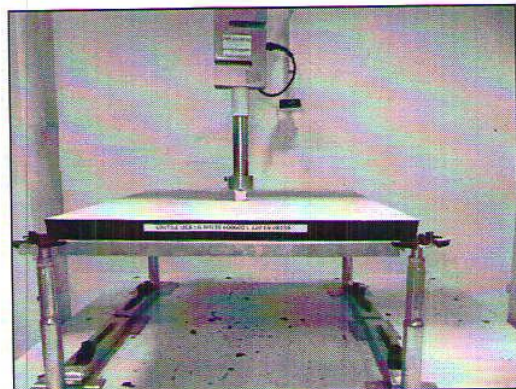

**TEST UNDER PROGRESS**

\* As furnished by the customer

- Note:
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

Radhakrishna  
Manager - Lab



Civil-Aid Technoclinic Pvt. Ltd.  
(A Bureau Veritas Group Company)  
43, 45, 46 & 47, Pete Chennappa Inds. Estate  
Ground & 1st Floor, 1st Main, Magadi Road  
Kamakshipalya, Bangalore - 560 079, India  
Tel : +91 80 23011800 Fax: +91 80 26716833

Head. Off.: Marwah Centre, 6th Floor  
Marwah Marg, Andheri (E), Mumbai - 72  
Tel: +91 22 66956300 Fax: +91 22 66956309  
bangalore.lab@in.bureauveritas.com  
www.civilaid.com  
CIN: U28120MH1997PTC260040

Bangalore (Corp. Off) Tel.: +91 80 39950500  
Chennai (Off/Lab) Tel.: +91 44 31924060  
Cochin (Off/Lab) Tel.: +91 484 2108800  
Hyderabad (Off) Tel.: +91 40 66824582  
Hyderabad (Lab) Tel.: +91 40 64584582  
Mangalore (Off/Lab) Tel.: +91 824 2213571