



**BUREAU  
VERITAS**

Ref: BVIPL/SPL/BL/630/6/2017/163  
Test Order dated: 07.06.2017

Date: 1.09.2017

1/2

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan, Dist. Valsad – 396150  
Gujarat

**TEST REPORT ON ACCESS FLOORING SYSTEM**

Source of sample / material : Access Flooring System verified at M/s United Office Systems Pvt. Ltd.  
Customer reference : Email dated: 07.05.2017 and 1.09.2017  
Date of test : 10.06.2017  
Tests Conducted : Rolling Load Test  
Sample Identification\* : Steel Cementitious Panels with folded edge (Bare)  
Product Model No.\* : "UNITILE UFP 30 1650"  
Product code No.\* : "UNITILE UFP 30 1650 B 000 00 00000"  
Equipment used\* : a. Rolling Load Test Machine  
b. Digital Dial Indicator, Sr. No.  
13121370 Calibration Date: 09.03.2017, Due Date: 08.03.2018)  
Panel size (Nominal)\* : 600 mm x 600 mm  
Thickness /Gross weight of Panel\* : 30 mm/ 13.000 kg.  
Test Method : CISCA 2007, Section-3  
Witness by/Date of visit : Mr. Radhakrishna, Consultant  
Bureau Veritas, India Pvt.Ltd, Bangalore on 10.6.17

**TEST RESULTS**

Table 1: Rolling load test by 6"x2" urethane tread wheel

Sample Reference	UNITILE UFP 30 1650 Bare				
	180 (400)				
Test load in Kg(lbf)	0 Pass	500 Passes	5,000 Passes	10,000 Passes	Deflection at 10000 passes relative to 0 pass
Measurement taken at (Refer below sketch)					
Edge 1-2	0.13	0.11	0.11	0.09	-0.04
Edge 2-3	0.10	0.09	0.09	0.05	-0.05
Edge 3-4	0.18	0.16	0.16	0.15	-0.03
Edge 4-1	0.03	0.03	0.02	0.01	-0.02
Diagonal 1-3	-0.42	-0.65	-0.73	-0.75	-0.33
Diagonal 2-4	-0.32	-0.46	-0.49	-0.55	-0.23
Center A	0.19	0.16	0.09	0.08	-0.11
Center B	-0.09	-0.12	-0.18	-0.21	-0.12
Center C	0.08	0.02	-0.03	-0.06	-0.14
Center D	0.26	0.24	0.14	0.13	-0.13
Center E	0.05	0.02	-0.01	-0.09	-0.14
Center F	0.24	0.19	0.19	0.18	-0.06

contd.....

*Sanjeev Patgar*  
07/09/2017

**SANJEEV PATGAR**  
Manager LAB



Bureau Veritas (India) Private Limited  
(Construction Services Laboratory)  
43, 45-47, Pete Chennappa Inds. Estate, 1st Main  
Magadi Road, Kamakshipalya, Bangalore - 560 079  
Tel.: +91 80 23011800 Fax: +91 80 26716833  
bangalore.lab@in.bureauveritas.com

Regd. Off. : Marwah Centre, 6th Floor  
K. Marwah Marg, Off Saki-Vihar Road  
Andheri (East), Mumbai - 400 072. India  
Tel.: +91 22 66956300 Fax: +91 22 66956309  
www.bureauveritas.co.in  
CIN : U74210MH2001PTC134262

Offices/Labs at: Ahmedabad, Baroda  
Bhopal, Chennai, Cochin, Coimbatore  
Delhi, Goa, Hubli, Hyderabad, Indore  
Jaipur, Kakinada, Kandla, Kolkata, Ludhiana  
Mangalore, Nagpur, Nashik, Pune, Raipur  
Surat, Trichy & Visakhapatnam

Ref: BVIPL/SPL/BL/630/6/2017/163  
Test Order dated: 07.06.2017

Date: 1.09.2017

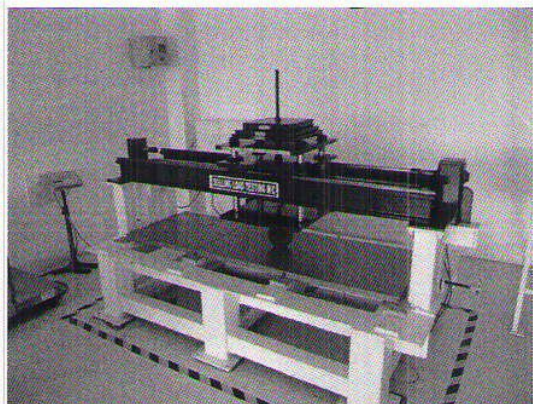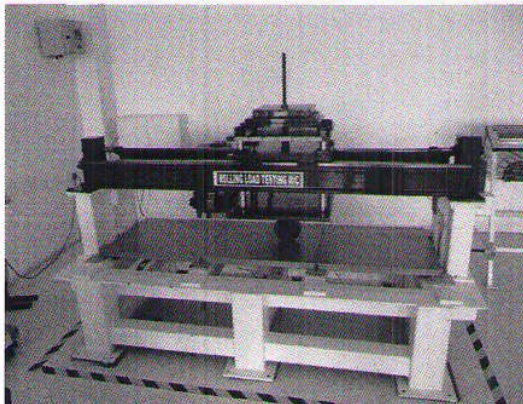


UNITILE UFP 30 1650 Bare - TEST UNDER PROGRESS

Remarks : All negative denote downward deflection.

\* As furnished by the customer

- Note:
1. The results relate only to the items tested.
  2. Report shall not be reproduced, except in full without the written approval of the lab.
  3. Any correction invalidates this report.

for BUREAU VERITAS (INDIA) PRIVATE LIMITED  
Construction Services Laboratory

  
02/09/2017  
SANJEEV PATGAR  
Manager LAB