



CIVIL - AID

Ref:CIVIL AID:spl:BL/2330-v/01/2016
Test Order dated: 15.09.2015

Date: 26.02.2016

United office systems Pvt. Ltd.
Survey No 62/1P , 1,2 & 3 ,Village- Vankas
Taluka : Umbergaon ,Dist . Valsad
Gujarat - 3961050



TEST REPORT ON ACCESS FLOORING SYSTEM

30
Date of test : 26.02.2016
Tests Conducted : Uniform Load Test
Sample Identification* : Steel Cementitious Panels with folded edge
Product Model No.* : UNITILE UFP 30 1650 Bare
Product code No.* : UNITILE UFP 30 1650
Equipment used : U.T.M (Load Cell, Sr. No. 4000432, Maximum Capacity 4 Ton, Calibration date: 03.04.2015, Due Date: 03.04.2016 & Digital Dial Indicator, Sr. No. 030948 Calibration Date: 10.03.2015, Due Date: 09.03.2016)
Panel size (Nominal) : 600 mm x 600 mm
Panel Thickness / Gross weight of Panel : 30 mm / 13.000 kg.
Test Method : CISCA 2007- Section 7
Witness By : Mr. Radhakrishna
Bureau Veritas , Civil – Aid Techno Clinic Pvt. Ltd, Manager -Lab

TEST RESULTS

Uniform Load Test

Sample reference	UNITILE UFP 30 1650 Bare
Test height in mm.	300
Location of measurement	Center
Deflection(mm) at pre-load of 50lb/ft ²	0
Withstand Maximum Load at 2.54 mm Deflection	1905 kg./m ²
Residual deflection (mm) at pre-load	0.12

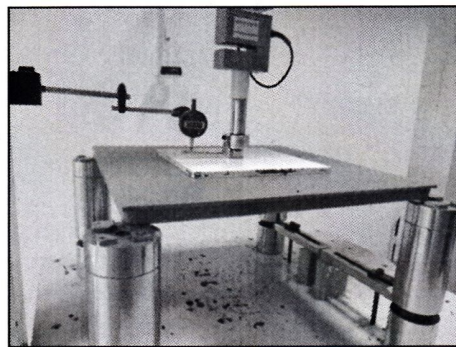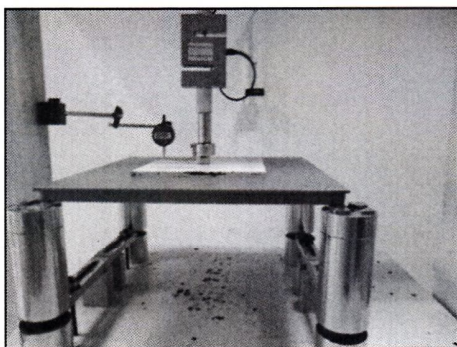

UNITILE UFP 30 1650 Bare

TEST UNDER PROGRESS

* As furnished by the customer

- Note:
1. The results relate only to the items tested.
 2. Report shall not be reproduced, except in full without the written approval of the lab.
 3. Any correction invalidates this report.

for **CIVIL AID TECHNOCLINIC PVT. LTD**


Radhakrishna
Manager - Lab