



CIVIL-AID

Ref:CIVIL AID:spl:4/1314 (ap)  
Test Order dated: 17.04.2013

Date: 30.04.2013

M/s. United Office Systems Pvt. Ltd.,  
Plot No. -62/1, 2 & 3, Vill-Vankas,  
Taluka-Umbergoan,  
Dist. Valsad – 396150,  
Gujarat , India

Attn.: Sri. Shabbir Rajkotwala

### TEST REPORT ON ACCESS FLOORING SYSTEM

Source of sample : Sample supplied by the customer  
Customer's Reference : E mail letter dated 22.03.2013  
Date of test : 15.04.2013  
Tests Conducted : Rolling Load Test : Wheel A -10 passes  
Sample Identification\* : Steel Cementitious Panels with folded edge  
Product Model No.\* : "UNITILE UNIFOLD UFP 1000 Folded Edge (Bare)"  
Product code No.\* : UNITILE UFP 6400 1000 B 000 00 00000  
Panel size (Nominal) : 600 mm x 600 mm  
Thickness /Gross weight of Panel : 35 mm/ 15.200 kg.  
Test Method : CISCA 2003-2004 –  
Recommended test procedures for Access Floor

### TEST RESULTS

Table 1: Rolling Load Test by 3"x 1<sup>13/16</sup>" (76mm x 46mm) Wheel

Sample Reference	UNITILE UFP 35 1000 (Corner Lock) valid for FFH 150-600mm		
Test load in kg (lbf)	272 (600)		
Measurement taken at	0 pass	10 passes	Deflection at 10 passes relative to 0 passes
Edge 1-2 (mm)	-0.03	-0.56	-0.53
Edge 2-3 (mm)	-0.04	-0.44	-0.40
Edge 3-4 (mm)	-0.10	-0.40	-0.30
Edge 4-1 (mm)	-0.11	-0.55	-0.44
Diagonal 1-3 (mm)	-0.13	-0.68	-0.43
Diagonal 2-4 (mm)	-0.31	-0.62	-0.31
Center A (mm)	-0.14	-0.53	-0.39
Center B (mm)	-0.03	-0.42	-0.40
Center C (mm)	-0.08	-0.43	-0.35
Center D (mm)	-0.15	-0.45	-0.30
Center E (mm)	-0.13	-0.67	-0.55
Center F (mm)	-0.08	-0.59	-0.51

Note: All negative denote downward deflection

*Handwritten signature*  
30/4/13

RADHA KRISHNA  
Sr. Technical Officer




Contd.....


Civil-Aid Technoclinic Pvt. Ltd.  
1030, 13th Cross  
Banashankari 2nd Stage  
Bangalore - 560 070. India

Tel. : +91 80 39950500, 26716831  
Fax : +91 80 26716833  
ctccivilaidinfo.in@in.bureauveritas.com  
www.civilaid.com

Chennai (Off/Lab) Tel.: +91 44 24847345  
Hyderabad (Off) Tel.: +91 40 66824582  
Hyderabad (Lab) Tel.: +91 40 64584582  
Mangalore (Off/Lab) Tel.: +91 824 2213571

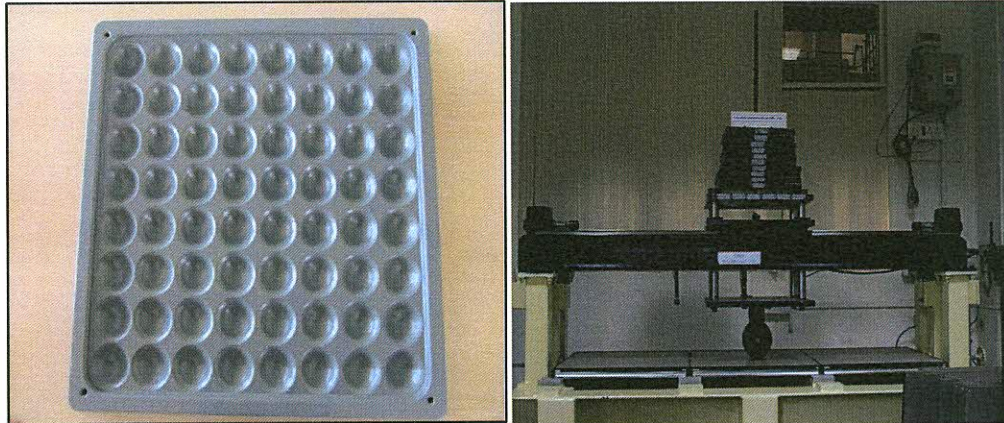

**PHOTO 1: Images of UNITILE UFP 35 1000 (Corner Lock) before /while Testing**

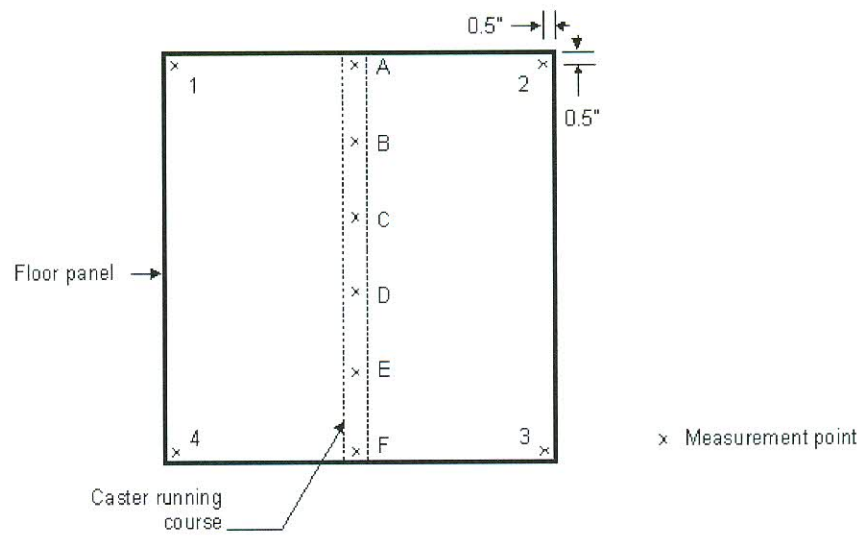

**Figure 1: Position of Measurement (Rolling Load)**

\* As furnished by the customer

- Note:
- 1.The results relate only to the items tested.
  - 2.Report shall not be reproduced, except in full without the written approval of the lab.
  - 3.Any correction invalidates this report.

for **CIVIL AID TECHNOCLINIC PVT. LTD.**

*Handwritten signature and date: 30/4/13*

**RADHA KRISHNA**  
Sr. Technical Officer

